




SGC-250 and SGC-250N

Single DECS Typical Connection

This publication contains confidential information of Basler Electric Company, an Illinois corporation. It is loaned for confidential use, subject to return on request, and with the mutual understanding that it will not be used in any manner detrimental to the interests of Basler Electric Company and used strictly for the purpose intended.

www.basler.com



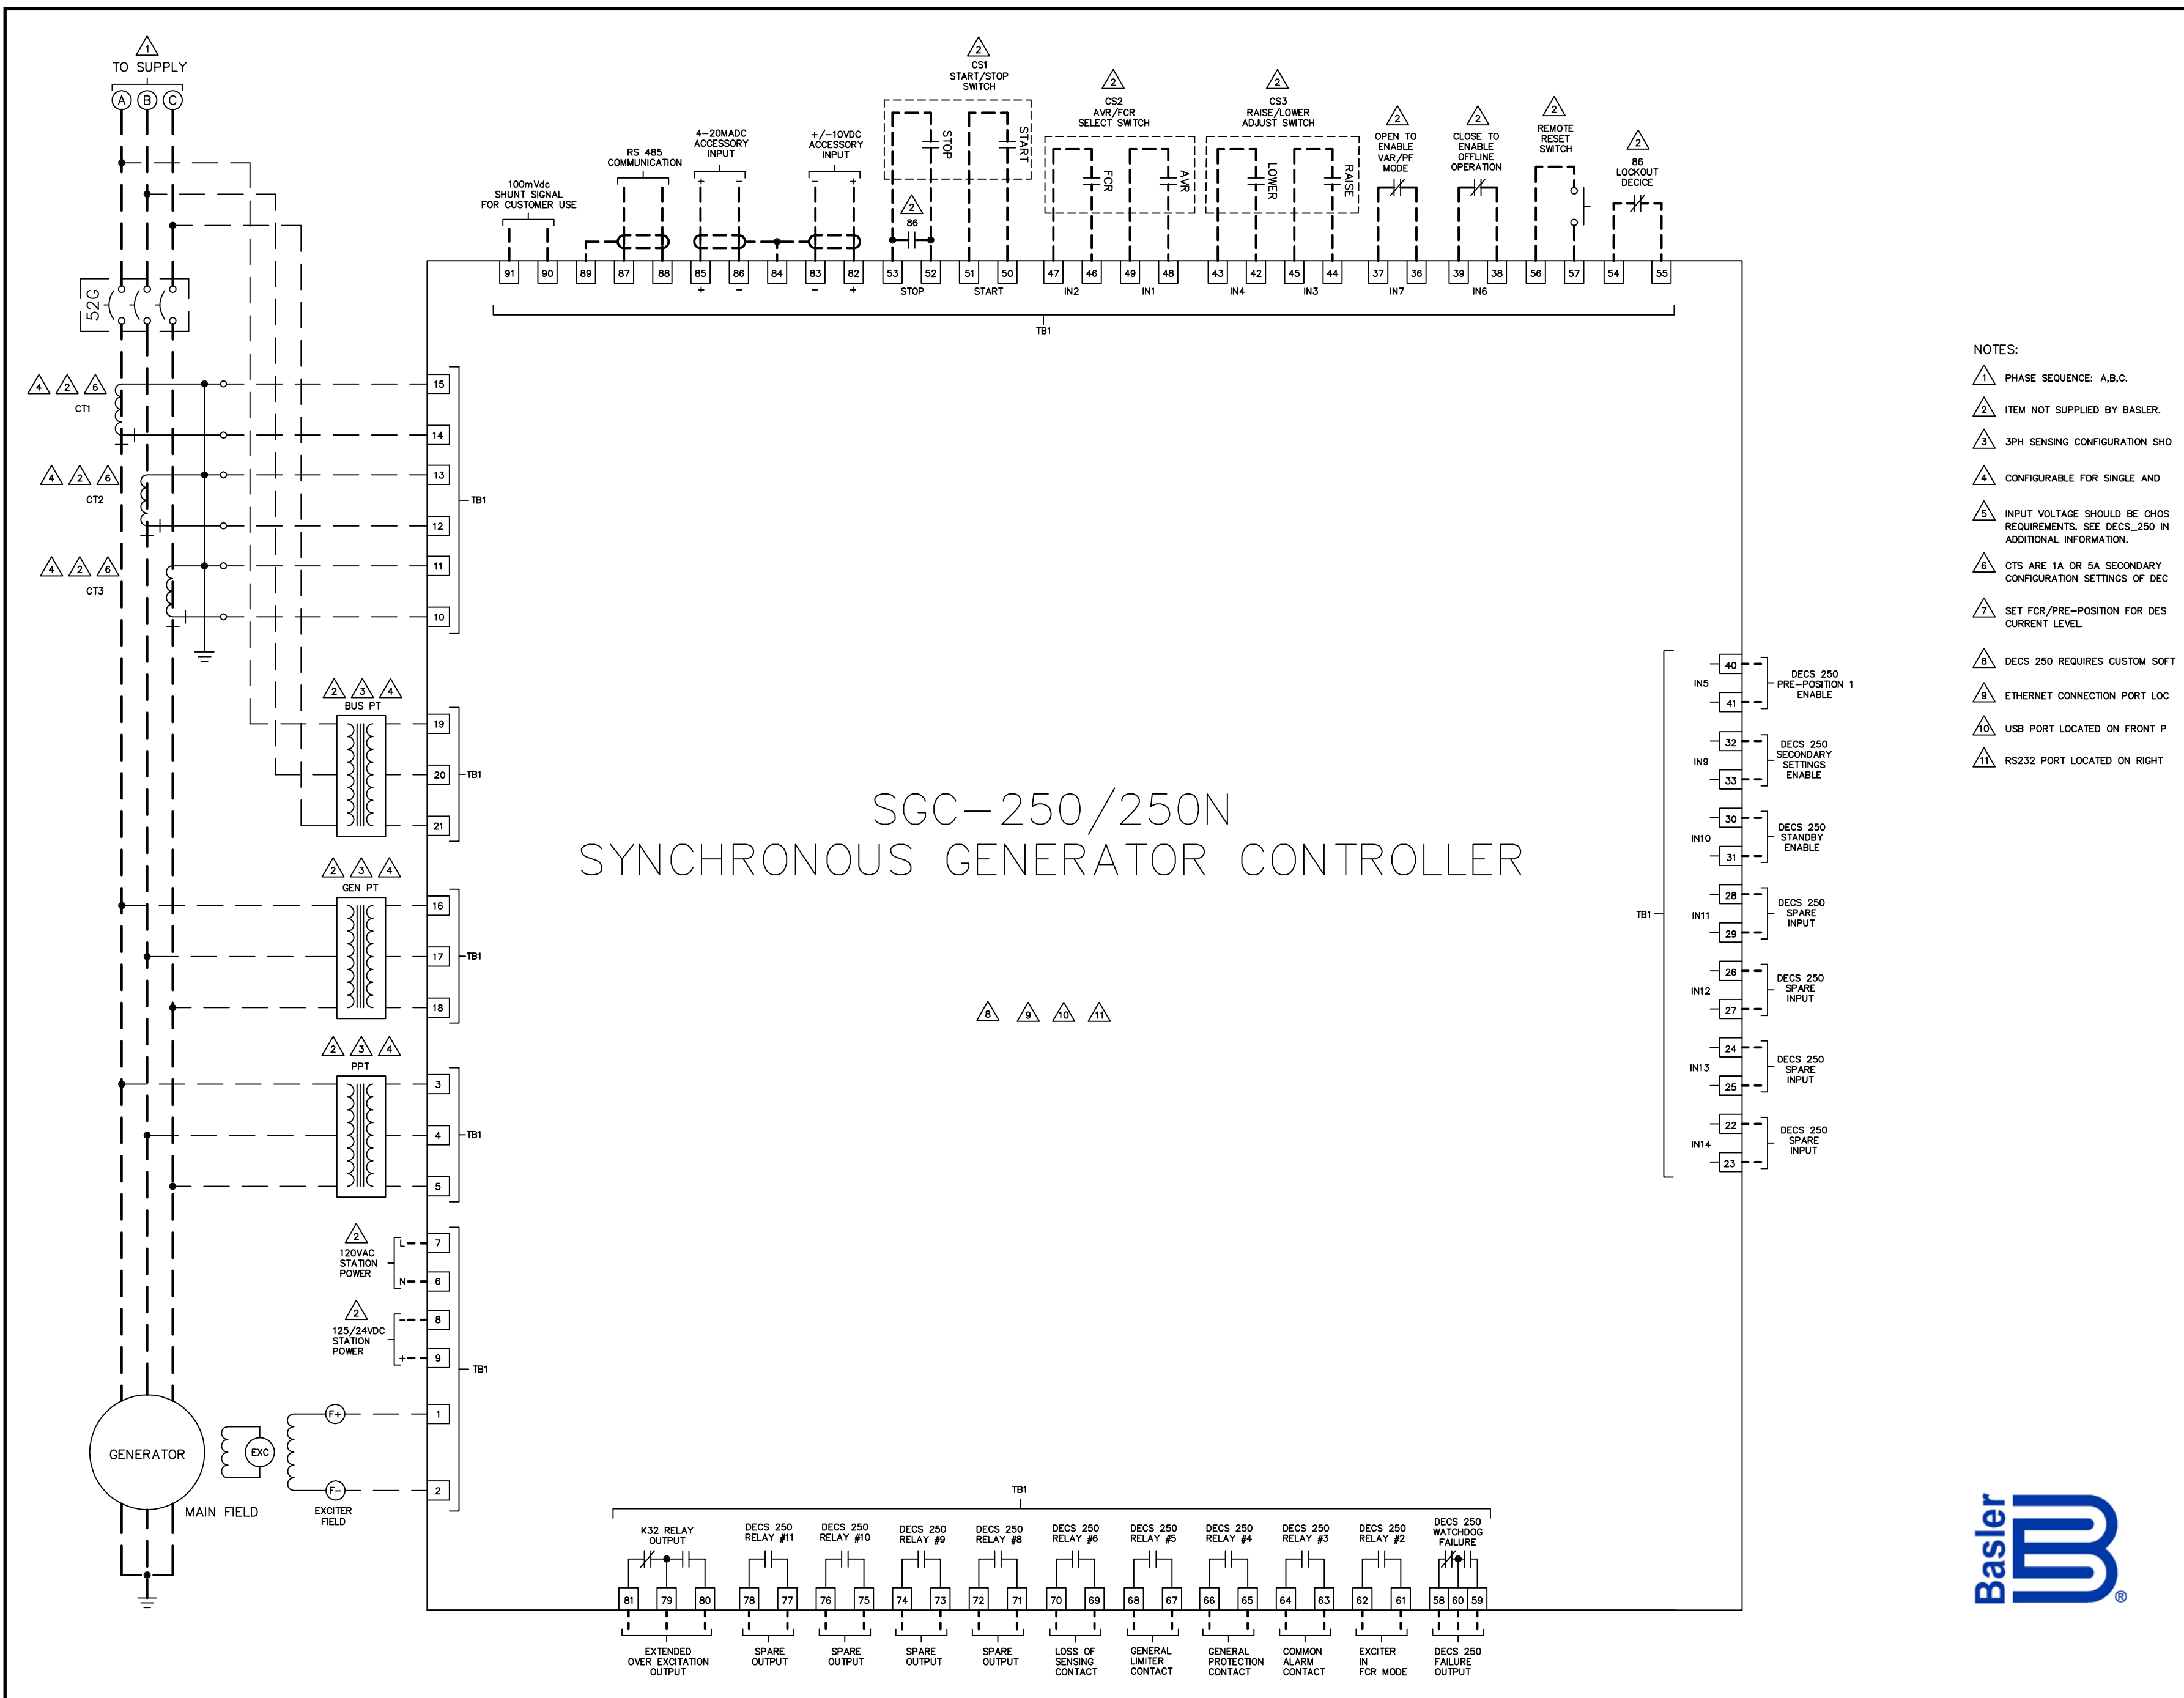

SGC-250/250N SYNCHRONOUS GENERATOR CONTROLLER

- NOTES:
- ① PHASE SEQUENCE: A,B,C.
 - ② ITEM NOT SUPPLIED BY BASLER.
 - ③ 3PH SENSING CONFIGURATION SHO
 - ④ CONFIGURABLE FOR SINGLE AND
 - ⑤ INPUT VOLTAGE SHOULD BE CHOS REQUIREMENTS. SEE DECS_250 IN ADDITIONAL INFORMATION.
 - ⑥ CTS ARE 1A OR 5A SECONDARY CONFIGURATION SETTINGS OF DEC
 - ⑦ SET FCR/PRE-POSITION FOR DES CURRENT LEVEL.
 - ⑧ DECS 250 REQUIRES CUSTOM SOFT
 - ⑨ ETHERNET CONNECTION PORT LOC
 - ⑩ USB PORT LOCATED ON FRONT P
 - ⑪ RS232 PORT LOCATED ON RIGHT

